


Data Sheet

045.7e

Transducers for AC Current or AC Voltage without Auxiliary Supply

AU 2.0
VU 2.0

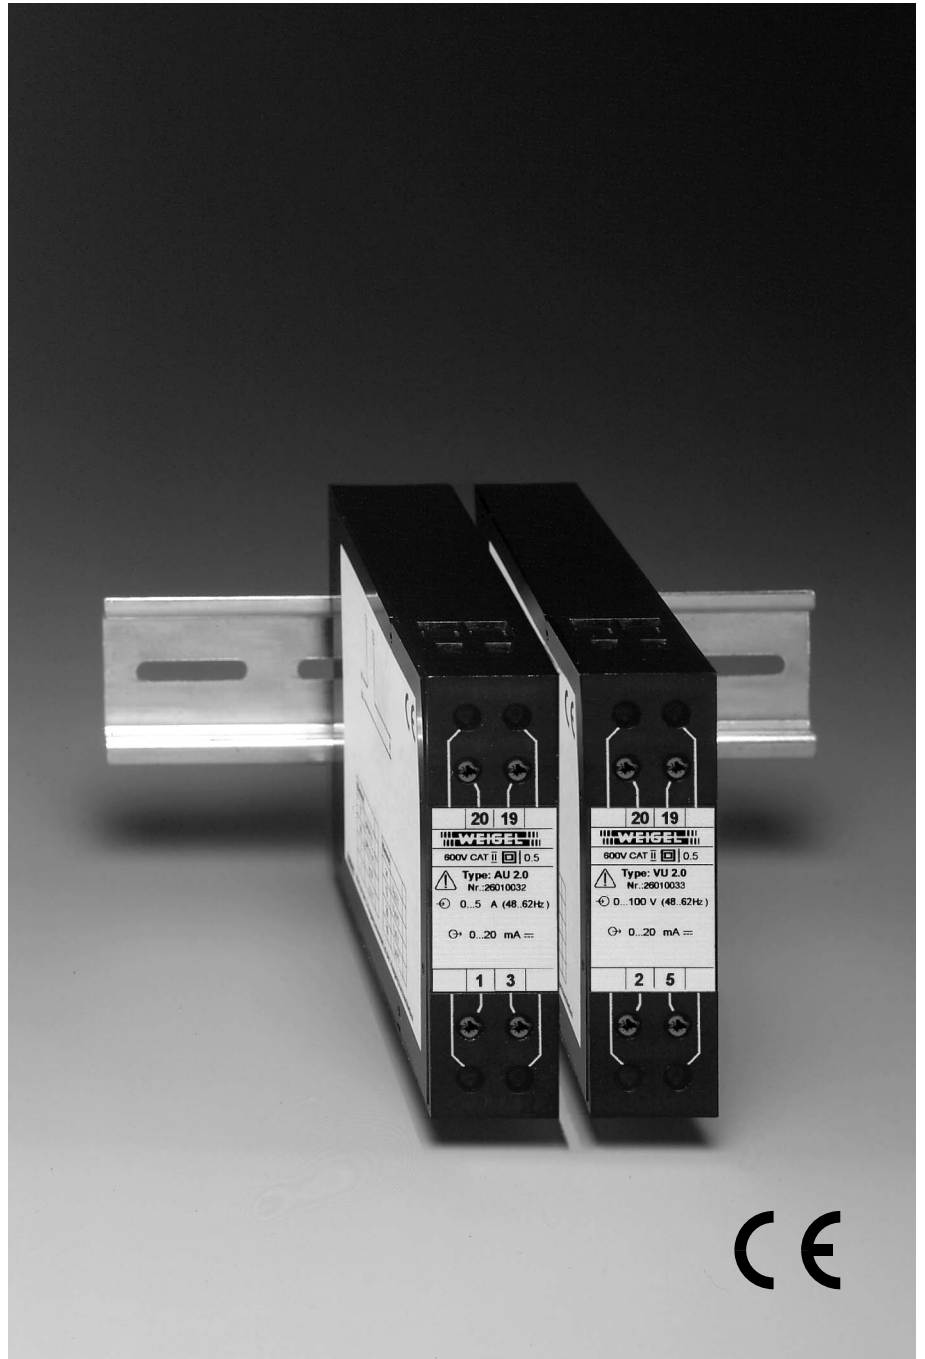

Application

The transducer models **AU / VU 2.0** convert **RMS values of sinusoidal AC currents resp. AC voltages** to a load independent DC current output signal. This signal can be transmitted over a considerable distance and fed into indicators, recorders and/or control systems.

It is possible to connect more than one measuring or control device to the output circuit provided the total impedance does not exceed the rating.


Input and output circuits are **galvanically isolated from each other**. The output circuit is **short-circuit proof** and **safe against idling**.

The transducers are designed to be mounted in machines/systems. Regulations for installation of electrical systems and equipment have to be observed.

Operating Principle

The AC input current/voltage is galvanically isolated, rectified and fed into a network which produces a load independent DC output current proportional to the input signal.

Block Circuit Diagram



General Data

case details	projecting case clamping to TH 35 DIN rail according to DIN EN 60 715
material of case	ABS/PC black self-extinguishing to UL rating 94 V-0
terminals	screw-terminals
wire cross-section	4 mm ² max.
enclosure code	IP 40 case IP 20 terminals
dielectric test	2210 V input to case, 3536 V output to case, measuring circuit to output
operating voltage	300 V (rated voltage phase to zero)
class of protection	II
measurement category	CAT III
pollution level	2
dimensions WxHxL	22.5 mm x 80 mm x 115 mm
weight	approx. 0.35 kg

Inputs


input rating	sinusoidal AC current (AU 2.0) sinusoidal AC voltage (VU 2.0)	
frequency range	48 ... 62 Hz	
power consumption	voltage transformer < 3 VA current transformer 5A < 4 VA current transformer 1A < 2 VA	
operating voltage	519 V max.	
input	AU 2.0 rated current $I_{EN} \blacktriangleright$	VU 2.0 rated voltage $U_{EN} \blacktriangleright$
	1 A *)	57.7 V (100 V : $\sqrt{3}$)
	1.2 A	63.5 V (110 V : $\sqrt{3}$)
	5 A *)	100 V *)
	6 A	110 V *)
		150 V
		250 V
		400 V
		500 V
	*) also for use on transformer	
measuring range	AU 2.0 0 ... I_{EN}	VU 2.0 0 ... U_{EN}
modulation range	1.2 I_{EN}	1.2 U_{EN}
overload limit	1.5 I_{EN} continuously 10 I_{EN} 1 s max.	1.2 U_{EN} continuously 2 U_{EN} 1 s max.

Outputs

current output	
output current	I_A load independent DC current
rated current	I_{AN} 0 ... 20 mA
load range	R_A 0 ... 500 Ω
load error	$\leq 0.4\%$ based on 50% load change
idling voltage	≤ 20 V
residual ripple	AU 2.0 3 mV _{eff} approx. VU 2.0 9 mV _{eff} approx.
based on R_A max.	
response time	AU 2.0 ≤ 300 ms VU 2.0 ≤ 100 ms
based on R_A max.	

Input and output circuits are galvanically isolated.

Conversion Characteristics




Input 0 ... I_{EN} / 0 ... U_{EN}
Output 0 ... 20 mA

Auxiliary Supply

not required

\blacktriangleright for other ratings refer to **Extras**



Transducers for AC Current or AC Voltage without Auxiliary Supply

Accuracy at Reference Conditions

accuracy class 0.5 ($\pm 0.5\%$ of end value)
 temperature coefficient $\leq 0.003\%/K$

reference conditions

frequency 50 ... 60 Hz
 wave form sine wave, distortion factor $\leq 0.1\%$
 load $0.5 R_{A \max} \pm 1\%$
 ambient temperature $23^\circ C \pm 1K$
 warm-up ≥ 1 min

Environmental

climatic suitability climatic class 3 to VDE/VDI 3540 sheet 2
 operating temperature range $-10 \dots +55^\circ C$
 storage temperature range $-25 \dots +65^\circ C$
 relative humidity $\leq 75\%$ annual average, non-condensing

Rules and Standards


- DIN EN 60 529 Enclosure codes by housings (IP-code)
- DIN EN 60 688 Electrical measuring transducers converting AC quantities into analog or digital signals
- DIN EN 60 715 Dimensions of low voltage switching devices: standardized DIN rails for mechanical fixation of electrical devices in switchgears
- DIN EN 61 010-1 Safety requirements for electrical measuring, control and laboratory equipment Part 1: General requirements
- DIN EN 61 326-1 Electrical equipment for measurement, control and laboratory use – EMC requirements Part 1: General requirements
- VDE/VDI 3540 sheet 2 Reliability of measuring and control equipment (classification of climates for equipment and accessories)

Extras


input ratings
 rated current I_{EN} deviating from standard inputs on request
 rated voltage U_{EN} deviating from standard inputs on request

Connections


current

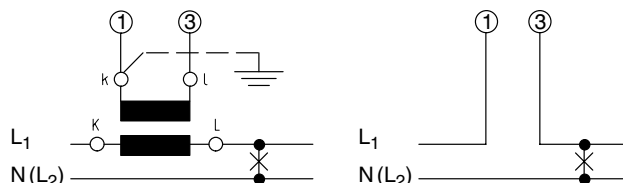

voltage

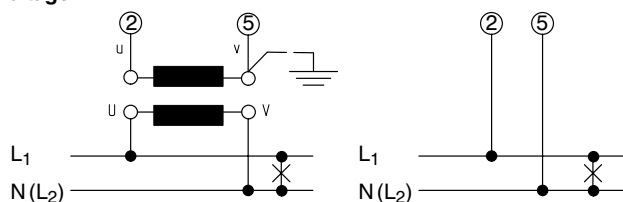


Terminals

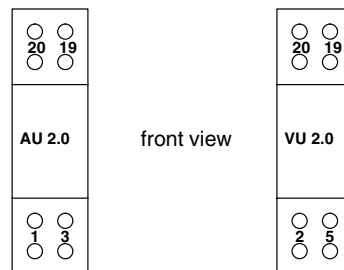

terminal	AU 2.0	VU 2.0
1	I_E	–
2	–	U_E
3	I_E	–
5	–	U_E
19	$I_A (+)$	$I_A (+)$
20	$I_A (-)$	$I_A (-)$

I_E current input
 U_E voltage input
 The numbers on the terminals conform to details in connection diagrams (refer to DIN 43 807).
 I_A current output

Dimensions

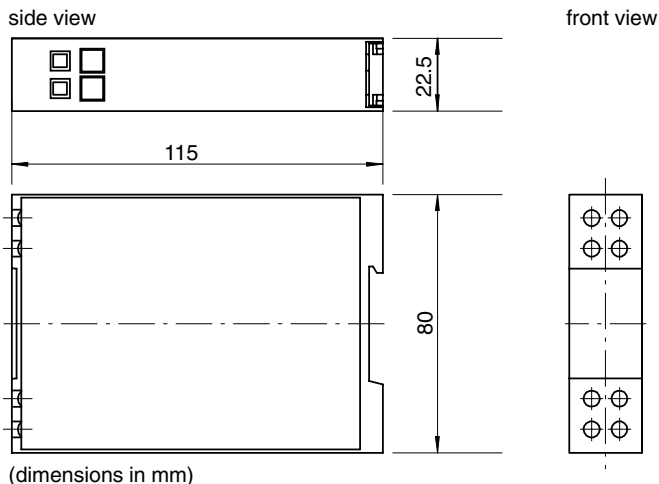

Ordering Guide

type	transducers
	power current units
	without auxiliary voltage, class 0.5
AU 2.0	AC current
VU 2.0	AC voltage
	input AU 2.0
10	0 ... 1.0 A
12	0 ... 1.2 A
50	0 ... 5.0 A
60	0 ... 6.0 A
xx	special measuring range *)
	input VU 2.0
57,7	0 ... 57.7 V
63,5	0 ... 63.5 V
100	0 ... 100 V
110	0 ... 110 V
150	0 ... 150 V
250	0 ... 250 V
400	0 ... 400 V
500	0 ... 500 V
xxx	special measuring range *)
	output
5	0 ... 20 mA
	auxiliary supply
H0	none (not required)

*) on request

ordering example

AU 2.0	50	5	H0
--------	----	---	----

transducer for AC current 0 ... 5 A, output 0 ... 20 mA,
without auxiliary voltage

Weigel Meßgeräte GmbH

Postfach 720 154 • 90241 Nürnberg • Phone: 0911/42347-0
 Erlenstraße 14 • 90441 Nürnberg • Fax: 0911/42347-39
 Sales: Phone: 0911/42347-94
 Internet: <http://www.weigel-messgeraete.de>
 e-mail: vertrieb@weigel-messgeraete.de

– specifications subject to change without notice; date of issue 12/10 –

